

This is an Open Access document downloaded from ORCA, Cardiff University's institutional repository: <https://orca.cardiff.ac.uk/id/eprint/125710/>

This is the author's version of a work that was submitted to / accepted for publication.

Citation for final published version:

Kajati, Erik, Papcun, Peter, Liu, Chao, Zhong, Ray Y., Koziorek, Jiri and Zolotova, Iveta 2019. Cloud based cyber-physical systems: Network evaluation study. *Advanced Engineering Informatics* 42 , 100988. 10.1016/j.aei.2019.100988

Publishers page: <http://dx.doi.org/10.1016/j.aei.2019.100988>

Please note:

Changes made as a result of publishing processes such as copy-editing, formatting and page numbers may not be reflected in this version. For the definitive version of this publication, please refer to the published source. You are advised to consult the publisher's version if you wish to cite this paper.

This version is being made available in accordance with publisher policies. See <http://orca.cf.ac.uk/policies.html> for usage policies. Copyright and moral rights for publications made available in ORCA are retained by the copyright holders.



Cloud Based Cyber-Physical Systems: Network Evaluation Study

Erik Kajati^{a,*}, Peter Papcun^a, Chao Liu^b, Ray Y. Zhong^c, Jiri Koziorek^d,
Iveta Zolotova^a

^a*Department of Cybernetics and Artificial Intelligence, Faculty of Electrical Engineering
and Informatics, Technical University of Kosice, Slovakia*

^b*High-Value Manufacturing Research Group, School of Engineering, Cardiff University,
United Kingdom*

^c*Department of Industrial and Manufacturing Systems Engineering, The University of
Hong Kong, Hong Kong*

^d*Department of Cybernetics and Biomedical Engineering, Faculty of Electrical Engineering
and Computer Science, VSB - Technical University of Ostrava, Czech Republic*

Abstract

In recent years, the Industry 4.0 concept brings new demands and trends in different areas; one of them is distributing computational power to the cloud. This concept also introduced the Reference Architectural Model for Industry 4.0 (RAMI 4.0). The efficiency of data communications within the RAMI 4.0 model is a critical issue. Aiming to evaluate the efficiency of data communication in the Cloud Based Cyber-Physical Systems (CB-CPS), this study analyzes the periods and data amount required to communicate with individual hierarchy levels of the RAMI 4.0 model. The evaluation of the network properties of the communication protocols eligible for CB-CPS is presented. The network properties to different cloud providers and data centers' locations have been measured and interpreted. To test the findings, an architecture for cloud control of laboratory model was proposed. It was found that the time of the day; the day of the week; and data center utilization have a negligible impact on latency. The most significant impact lies in the data center distance and the speed of the

*Corresponding author

Email addresses: erik.kajati@tuke.sk (Erik Kajati), peter.papcun@tuke.sk (Peter Papcun), liuc64@cardiff.ac.uk (Chao Liu), zhongzry@hku.hk (Ray Y. Zhong), jiri.koziorek@vsb.cz (Jiri Koziorek), iveta.zolotova@tuke.sk (Iveta Zolotova)

communication channel. Moreover, the communication protocol also has impact on the latency. The feasibility of controlling each level of RAMI 4.0 through cloud services was investigated. Experimental results showed that control is possible in many solutions, but these solutions mostly can not depend just on cloud services. The intelligence on the edge of the network will play a significant role. The main contribution is a thorough evaluation of different cloud providers, locations, and communication protocols to provide recommendations sufficient for different levels of the RAMI 4.0 architecture.

Keywords: Cloud, Cyber-Physical Systems, Industry 4.0, Microsoft Azure, Network evaluation, RAMI 4.0

1. Introduction

Industry 4.0 facilitates the vision and execution of a Smart Factory. Within the modular structured Smart Factories, Cyber-Physical Systems (CPS) monitor physical processes, create a virtual copy of the physical world and make decentralized decisions. Over the Internet of Things (IoT), CPS communicate and cooperate with each other and with humans in real time, and via the Internet of Services, both internal and cross-organizational services are offered and utilized by participants of the value chain [1].

There are four design principles in Industry 4.0 that support companies in identifying and implementing Industry 4.0 scenarios [2]: interoperability; information transparency; technical assistance; decentralized decisions.

Cloud computing, also known as on-demand computing, is a kind of Internet-based computing that provides shared processing resources and data to computers and other devices on demand. It is a model for enabling ubiquitous, on-demand access to a shared pool of configurable computing resources (e.g., networks, servers, storage, applications, and services), which can be rapidly provisioned and released with minimal management effort. Cloud computing and storage solutions provide users and enterprises with various capabilities to store and process their data in third-party data centers

20 [3].

The Industrial Internet of Things (IIoT) is part of the IoT concept. IIoT solution is created when IoT principles are applied to the manufacturing industry. IIoT has been heralded primarily as a way to improve operational efficiency. However, in today's environment, companies can also benefit greatly from seeing it as a tool for finding growth in unexpected opportunities. In the future, successful companies will use the IIoT to capture new growth through three approaches: boost revenues by increasing production and creating new hybrid business models, exploit intelligent technologies to fuel innovation, and transform their workforce [4].

30 The Platform Industrie 4.0 introduced the Reference Architectural Model for Industry 4.0 (RAMI 4.0) which merges industry hierarchy levels architecture (ANSI/ISA 95), life cycle value stream architecture, and Smart Industry/Industry 4.0 ideas (Fig. 1). RAMI 4.0 is a three-dimensional map showing how to approach the issue of Industrie 4.0 in a structured manner, it also combines all elements and IT components in a layer and life cycle model. [5]

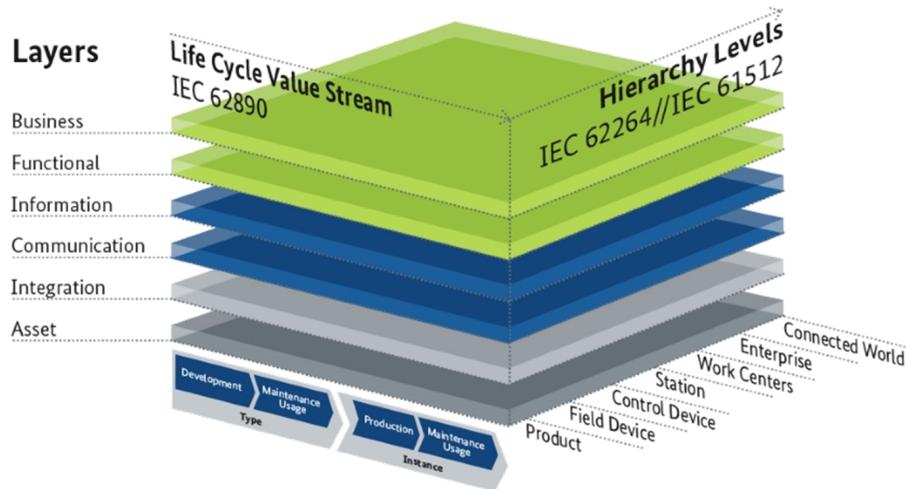


Figure 1: Reference Architectural Model for Industry 4.0. [5]

The efficiency of data communications within the RAMI 4.0 model is a critical issue that significantly affects the performance of the whole system. Aiming to evaluate the efficiency of data communication in the Cloud Based
40 Cyber-Physical Systems (CB-CPS), this study analyzes the time periods and data amount required to communicate with individual hierarchy levels of the RAMI 4.0 model, from product to enterprise level. It is noted that the data amount and latency requirements for each level are different regarding their specific requirements. The higher levels exchange more data less frequently;
45 on the contrary, the lower levels require faster communication with less data amount. In addition, the individual levels also communicate with each other to exchange information through the hierarchy levels. The specific requirements of each individual level are summarized as follows:

- Enterprise level (ERP - Enterprise Resource Planning) offers production
50 planning, service delivery, marketing and sales, financial modules, retail, and support algorithms for decision making. Analyses of big amounts of data (from megabytes to terabytes) need to be performed in this level, and hence the time periods are usually higher than several minutes.
- Work Centers level (MES - Manufacturing Execution System) includes
55 warehouse management, quality management, production records, repair management and prevention, and operational planning. This level usually transfers tens of megabytes of data; while the time periods are from seconds to minutes.
- Stations level contains Supervisory Control and Data Acquisition
60 (SCADA) and Human-Machine Interfaces (HMI). Data amounts are from kilobytes to megabytes; while time periods are usually from tens of milliseconds to less than one second.
- Control Device level includes devices such as Programmable Logic
65 Controllers (PLC) and industrial computers. Data amounts are from bytes to kilobytes and time periods are from microseconds to seconds.

- Field Device level includes sensors and actuators. Data amounts are from bytes to kilobytes and time periods are from microseconds to seconds.

The industry has been gradually distributing computational power to the cloud, though the progress was slow due to security concerns. At the early stage, 70 the top-level information systems have been migrated to the cloud, examples being the SAP HANA, Wonderware MES, etc. Recently, in light of the Industry 4.0, there is a trend to migrate the SCADA systems and HMIs to the cloud, in case they do not require responses faster than 500ms.

When the user turns on the switch, delay should not be greater than 100ms 75 to provide fluid reactions. In case of Augmented Reality-based HMIs, the reaction of the HMIs should be around 40ms to maintain at least 25 frames per second refresh rate. Otherwise, the projected images would not look continuous. Other systems, like AC motors need control period in microseconds. Nowadays, migration of some control devices to the cloud is not 80 possible, but some systems have slow dynamics, and they can be controlled through cloud, as is described in this article. In some cases, all levels of RAMI 4.0, from Control Device level to Enterprise level, can be migrated to the cloud, and this creates the CB-CPS.

The rest of this paper is organized as follows. Section 2 presents the 85 literature review. Section 3 deals with network evaluation using different protocols and locations that can be used for the Control Device level of the RAMI 4.0 architecture. Section 4 evaluates system control on the laboratory model. Conclusions and future work are drawn in Section 5.

2. Literature review

90 In recent years, the Industry 4.0 concept brings new demands and trends in different areas. Machine tools are changing in this industrial revolution and have also gone through different stages of technological advancements [6]. Cyber-Physical Machine Tools (CPMT) provides a promising solution for Machine Tool 4.0 a new generation of machine tools. Liu *et al.* [7], [8]

95 proposed a generic system architecture to provide guidelines for advancing
existing Computer Numerical Control (CNC) machine tools to CPMT. The
processes require more and more computational power. The end devices can
offer some of the computational power, but these devices often do not meet
the requirements for the computationally demanding processes. These
100 processes may include running algorithms of the computer vision, machine
learning, or data analytics [9], [10]. With the rapid development of computer
networks and Internet connections anywhere in the world, there is an
opportunity to offload some of the computationally demanding algorithms to
the cloud from the end devices.

105 Cloud and CPS are connected through the network, which forms the
Networked Control System (NCS). NCS is the control system in which the
components including controller, sensors, actuators and other system
components exchange the information using a shared media or network [11].
The development of NCS has been running for several decades. At the early
110 stage, it was solved within the LAN networks of companies. The results of the
mentioned research and development are deterministic industrial real-time
networks, such as ProfiNet, Ethernet/IP and EtherCAT. Nowadays, research
is moving further towards studying whether NCS can move beyond the
boundaries of companies to the cloud.

115 Givehchi *et al.* [12] presented a cloud-based solution that aims at offering
control-as-a-service for an industrial automation case (see Figure 2). According
to the authors, the PLC could not only remain in the shop floor as a physical
device, but also be implemented as a virtual entity and delivered to the field
as a service from a CPS via the network. Network rules and policies such as
120 access permissions for virtual machines defined for the cloud will be applied by
virtual switch (vSwitch) which is managed by vCloud Networking and Security
component using VMwares vCloud suite, which is connected to the Profinet
Real-Time Ethernet system (RT) via physical interface.

Their results showed that there is a reduction of performance for cloud-
125 based scenario compared with a hardware PLC. This reduction in performance

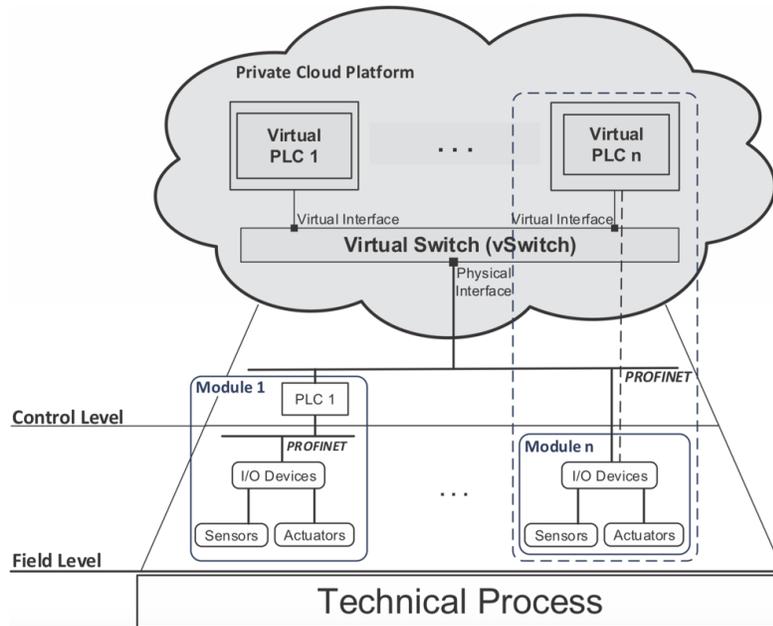


Figure 2: A generic cloud-based control approach [12].

is mostly in systems with higher sampling rates (32ms and faster). In processes that require sampling rate 64ms and slower, the difference between a cloud-based scenario and the hardware PLC is lower and mostly negligible, but it also depends on the type of the application. Hence, their solution is promising for soft real-time applications.

130 Schlechtendahl *et al.* [13] conducted two use cases of cloud-based control system using two milling machines. The data transferred between the control system and the machine tools have been analyzed. Then the data was used to analyze if a Control System as a Service (CSaaS) is possible. A communication test setup was developed as shown in Figure 3.

135 The cloud communication module located in Stuttgart, Germany, creates the data that is transferred from the cloud to the machine. The machine communication module, which receives the data from Stuttgart, is located either in Auckland, New Zealand or in Google cloud center located in Europe.

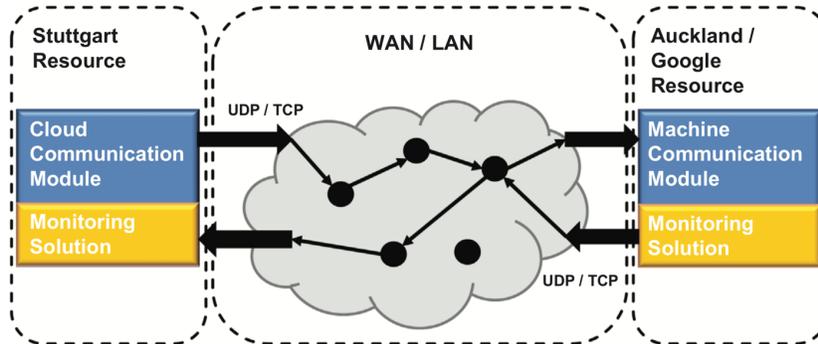


Figure 3: Test setup communication [13].

140 The machine communication module receives and logs the data, and as a second step creates and transmits the data from the machine to the cloud system. Communication channels can be configured for different connection protocols - User Data Protocol (UDP), Transmission Control Protocol (TCP) and WebSocket Protocol. The authors conclude that CSaaS between New Zealand and Germany is not possible due to serious network challenges. The control system should be located closer to the machine. CSaaS between the Google Cloud Centre in Europe and Germany is possible for processes that require slow cycle times [13].

150 According to Givehchi *et al.* [12], control of systems with sampling rate 64ms and slower can be cloud-based and differences between the hardware PLC and cloud-based scenarios are mostly negligible. Schlechtendahl *et al.* [13] concluded that CSaaS for processes that require slow cycle times is possible if the machine and cloud center are on the same continent.

155 Nowadays, a considerable amount of research works have been conducted on cloud-based access to devices through different protocols [14], [15] and frameworks [16]. Many researchers are working on the migration of low-level control to the cloud [12], [13], [17]. Furthermore, research has been conducted on the migration of high-level control to the cloud, concretely ERP, or MES systems [18], [19], [20]. In effect, most of the previous research works were dedicated to a certain level of RAMI 4.0. The lack of an overview of the

control in all levels of RAMI 4.0 represents the first research gap. This paper provides a broader view on which levels of the RAMI 4.0 can be migrated with specified conditions to the cloud. Details of this issue are discussed in the third chapter *Network evaluation*.

165 Research on the Quality of Control (QoC) via local NCS has also been investigated for several years (e.g. [21]). However, QoC via cloud NCS still remains an unresolved issue, which represents the second research gap. In this work, a laboratory model with sampling time 100ms and several cloud providers is developed to 1) demonstrate the proposed CB-CPS architecture, 2) verify the
170 feasibility of the CSaaS, and 3) evaluate the QoC via cloud NCS. The fourth chapter *Networked control system evaluation* introduces the development and the experimental results of the laboratory model.

3. Network evaluation

The experimental results of this research are analysed from two aspects in
175 two sections, respectively. This section deals with network properties using different protocols and control options. The following section evaluates system control using a different approach. If the control algorithm is migrated to the cloud, then the NCS is formed in large scale, where the PLC is replaced with the cloud. NCS is a control system where the control loops are closed through
180 a communication network.

To be able to evaluate the properties of the network, the theoretical and physical limitations need to be identified first. The fastest communication medium available is an optical fiber. If two outermost places in the world can be connected without intermediate network devices (switches, routers, repeaters), the theoretical latency is 134ms, as calculated in (1).
185

$$L = \frac{2\frac{C}{2}}{c} = \frac{40075km}{299792km/s} = 134ms \quad (1)$$

Two outermost places are $\frac{C}{2}$ apart (C is Earth's circumference), in reality, this distance is bigger, due to paths of the cables. Latency is the time between

sending and returning a packet, so the packet must pass that distance two times ($2\frac{C}{2}$). Parameter c is the speed of light and parameter L is latency. Real latency
190 can be reduced by technological progress, but cannot reach below the theoretical minimum. This implies that if the speed of light is the highest achievable speed, it will never be possible to control the system with sampling period lower than 134ms from two outermost places on Earth without using additional algorithms (for example, prediction algorithm).

195 In this research, the latency for the three most commonly used cloud providers, i.e. Amazon Web Services, Google Cloud Platform and Microsoft Azure is analyzed. Data centers located in west Europe (WestEU), east United States (EastUS), and eastern Australia (EastAU) were chosen. The air fly distance to data centers in WestEU is approx. 1 300km (theoretical
200 minimum according to (1) is 9ms); the distance to data center in EastUS is approx. 9 000 km (theoretical minimum according to (1) is 60ms); and the distance to data center in EastAU is approx. 15 000km away (theoretical minimum according to (1) is 100ms). The data center in Europe represents the fastest/closest data center. The data center in the United States
205 represents the intercontinental communication. The data center in Australia will provide communication with the outermost data center. Multiple measurements were made at different times of the day and for every day of the week during February 2019 from Technical University of Kosice, Slovakia. Specifically, measurements were made 1000 times every 2 hours from 1st
210 February at 12 am to 28th February at 10 pm, that is 336.000 measurements. Experimental results of the mean latency and the 10th percentile (90% of the values are better) are summarized in Table 1.

Based on the results from Table 1, the Microsoft Azure cloud platform has been chosen for this study. It is found that Microsoft Azure has the lowest
215 latency for the EastUS and WestEU from the three, although Google Cloud Platform has a slight better performance for the EastAU. For the laboratory testing model used in this research, the most important locations are those with a latency below or around 100ms. The reason for including EastAU in this

Table 1: Latency between east Slovakia and cloud providers' data centers.

Provider	Location	Mean latency	10th percentile
Amazon Web Services	WestEU	64.33ms	65ms
	EastUS	145.67ms	146ms
	EastAU	545.52ms	740ms
Google Cloud Platform	WestEU	37.58ms	38ms
	EastUS	111.92ms	113ms
	EastAU	301.25ms	302ms
Microsoft Azure	WestEU	30.51ms	31ms
	EastUS	106.07ms	107ms
	EastAU	316.54ms	339ms

research is to test the communication with the location that is the farthest from
the location of the laboratory model, i.e. Slovakia.

After chosen the Microsoft Azure as the cloud provider, the communication
protocols need to be selected and analyzed. In this research, the following four
communication protocols were selected:

- HTTP - Hypertext Transfer Protocol - commonly used protocol for
communication between server and clients [22].
- WCF - Windows Communication Foundation service - a framework for
building service-oriented applications [23]. WCF Web HTTP service was
chosen for measurements.
- OPC UA - Open Platform Communication Unified Architecture - a
machine to machine communication protocol for industrial automation
[24].
- AMQP - Advanced Message Queuing Protocol - publish-subscribe-based
messaging protocol, commonly used in IoT solutions [25].

Multiple measurements were made at different times of the day and for

235 every day of the week during March 2019 from Technical University of Kosice,
Slovakia. Specifically, measurements were made 1000 times every 2 hours from
1st March at 12 am to 31st March at 10 pm for all communication protocols,
that is 1.488.000 measurements. It is found that the time of the day and the
day of the week have a negligible impact on the latency. Therefore, the table
240 is not divided by the time of the measurement. The experimental results are
summarized and analyzed in Table 2. The minimum and maximum latency,
the median, mean, mode, and standard deviation for each protocol have been
summarized. Three percentile values (0.1th, 1st, 10th) which indicate 99.9%,
99%, and 90% of values that are better than the corresponding value are also
245 summarized in the table. The last three rows indicate the smallest interval in
which the value will be with 99.9%, 99%, and 90% probability.

As shown in Table 2, HTTP is the fastest communication protocol among
the four protocols, at all data centers locations. The overall order of the
communication protocols, based on the latency, grouped by the location are
250 the same for all locations. That means, data center utilization has minimal
effect on the latency; the most significant impact is on the distance to the data
center and the speed of the communication channel.

For a better representation of some statistical results, a box plot is made to
display the distribution of the latency values (Figure 4).

255 It can be seen from Table 2 and Figure 4 that the results from HTTP,
WCF and OPC UA are less scattered than that from AMQP communication.
Moreover, results from HTTP and WCF are very similar in all locations; OPC
UA is just slightly slower than the two mentioned. On the contrary, AMQP
communication is a lot slower compared to the other three; also the dispersion
260 of the values is a lot wider. To better understand the consistency of the latency
measurements, 1000 values (period: one message per second) of HTTP and
AMQP communication are selected and displayed in Figure 5 and Figure 6,
respectively.

The lower tier of the IoT Hub service, which was used for testing, allowed
265 100 cloud-to-device messages/unit/minute. When 100 messages were sent in

Table 2: Cloud control communication protocols evaluation.

Location	WestEU				EastUS				EastAU			
	HTTP [ms]	WCF [ms]	OPC [ms]	AMQP [ms]	HTTP [ms]	WCF [ms]	OPC [ms]	AMQP [ms]	HTTP [ms]	WCF [ms]	OPC [ms]	AMQP [ms]
Minimum	40	41	56	83	137	140	150	351	314	317	327	632
Maximum	221	194	216	338	226	208	315	596	450	343	420	763
Median	43	47	63	88	139	144	158	358	316	320	335	638
Mean	43.33	47.64	63.49	93.48	139.58	144.23	158.39	369.39	316.93	320.66	335.07	641.42
Mode	42	47	63	87	139	144	155	355	316	321	336	637
St. dev.	4.21	3.80	3.90	19.69	3.54	3.55	6.99	35.59	5.55	2.03	5.12	12.51
0.1th perc.	80	95	99	289	176	191	205	590	447	337	375	760
1st perc.	55	58	72	196	152	160	179	533	324	328	346	706
10th perc.	47	52	68	103	142	147	164	398	319	324	341	650
99.9% prob.	40-83	41-102	56-107	83-289	137-176	140-218	150-205	351-590	314-448	317-337	327-375	632-760
99% prob.	41-60	42-61	57-76	84-210	137-155	141-161	151-184	352-559	315-326	317-328	328-352	633-723
90% prob.	41-47	43-52	59-68	85-113	138-144	142-147	152-164	354-455	315-321	318-324	329-341	635-659

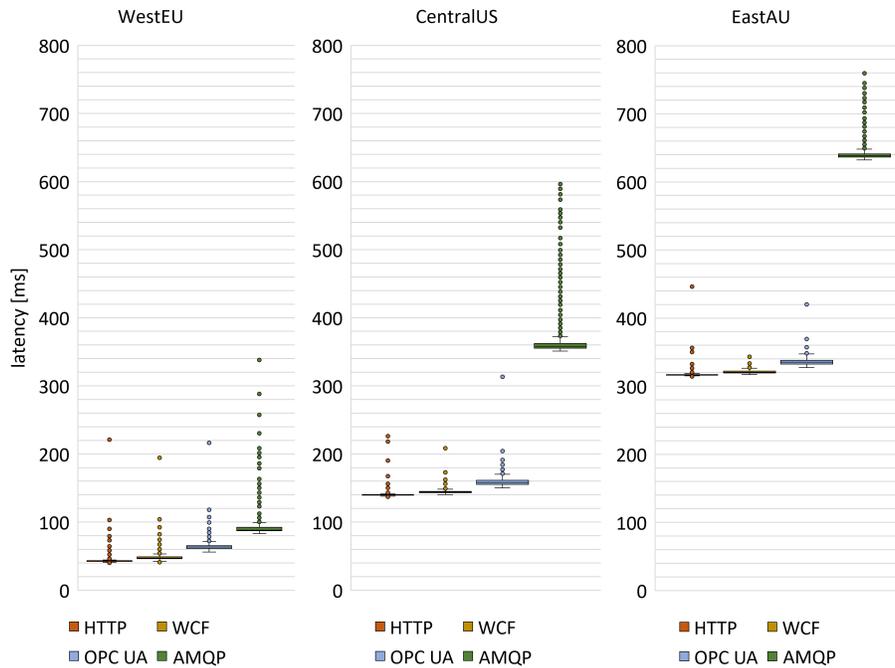


Figure 4: Distribution of the latency values grouped by location.

one minute interval, throttling was applied. Theoretically, the IoT Hub should be able to communicate at full speed for the first 10 seconds. However, it was noticed that it always took 3 to 5 seconds after reaching the limit of 1000 messages per minute until throttling was applied. At EastUS and EastAU locations, throttling was applied after a longer time interval. This was caused by the longer intervals between messages from the cloud to the device. Even if the requests were sent every 1ms, the average shortest interval was 150ms between responses from EastUS, and 320ms from EastAU (Figure 7). The top tier edition type of the IoT Hub can send as many as 5000 cloud-to-device messages/unit/minute, but it costs several thousands of euros per unit.

If the latency was known, it is able to analyze which communication protocols can be applied to the individual levels of the RAMI 4.0. Since the Station level mostly requires communication under one second, all of the tested protocols could meet this criterion, even the most distant location (EastAU) and the

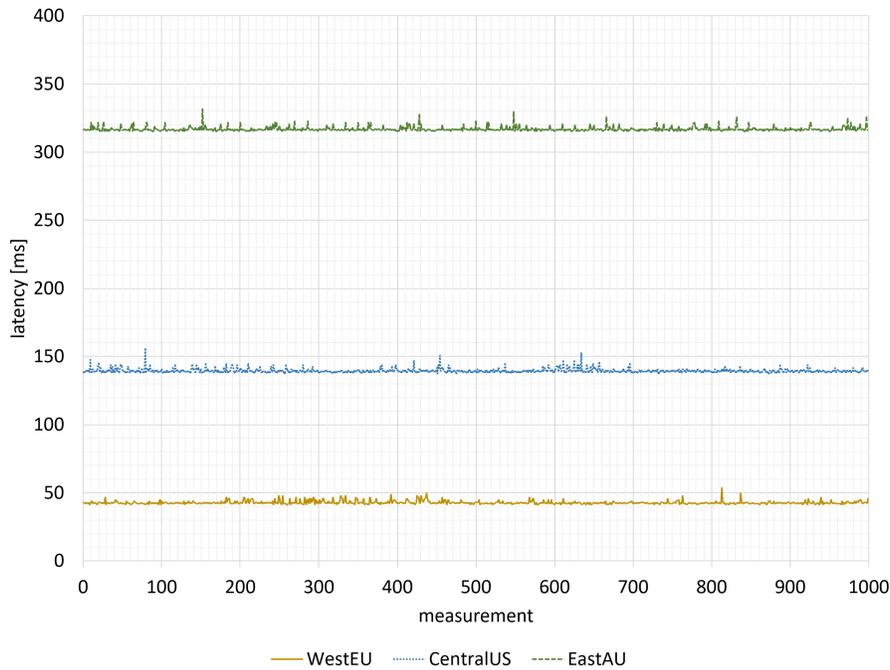


Figure 5: Consistency of the latency measurements - HTTP.

280 slowest protocol (AMQP) is sufficient, with 99.9% of the latency values under
 760ms. Higher levels (Work Centers, Enterprise) have lower demands on latency,
 but they have higher requirements on the data transfer speeds. Therefore, all
 higher hierarchy levels (Station, Work Centers, Enterprise) of RAMI 4.0 can
 be controlled and executed through cloud services as long as the data transfer
 285 speeds are sufficient.

Since time periods required for the Control device level in RAMI 4.0 are from
 microseconds to seconds, we have split these periods into three main categories
 as follows:

- more than 1s – heating, ventilation, and air conditioning,
- 290 • 1s to 40 ms – lights, switches, relays,
- less than 40ms – drives, motors, manipulators, line scan cameras.

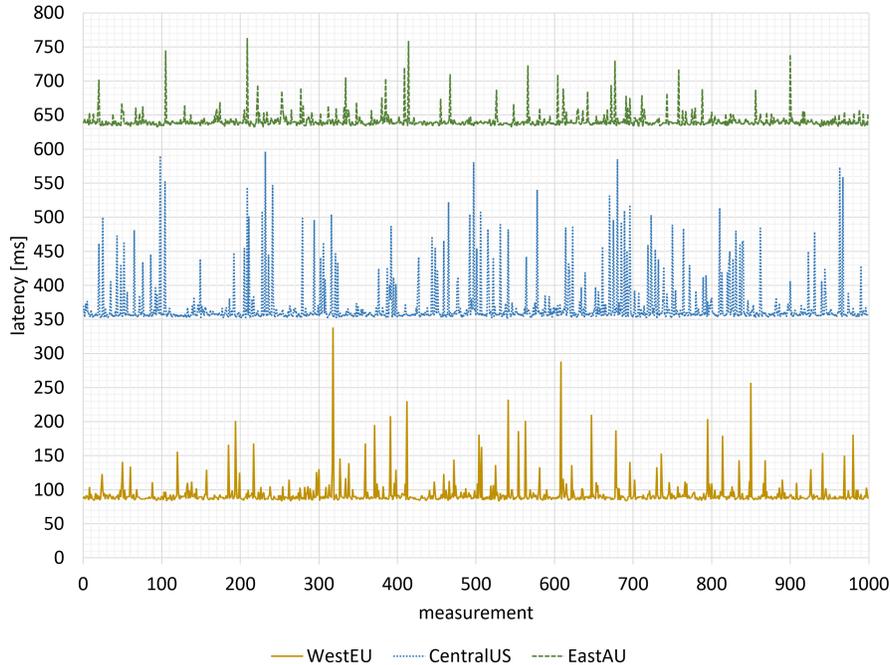


Figure 6: Consistency of the latency measurements - AMQP.

As described in Table 3, technological processes which do not require latency/control period lower than 1s, can be controlled through cloud services without dependencies on the type of communication service or the data centers' location. Moreover, a conclusion is summarized from our testing: processes that require latency/control period lower than 40ms cannot be controlled through cloud services. The third group of technological processes which require times between 1s and 40ms is dependent on the communication protocol and location of the cloud data center, or the speed of the communication channel between physical processes and data centers' location. The latency is subject to communication channel usage, not just the distance between communicating nodes; sometimes the faster channel could be the a more distant one. In this analysis, the computational complexity has been neglected at each RAMI4.0 level, because the cloud is highly scalable, and complex algorithms can be solved with hundreds or thousands of CPU cores in

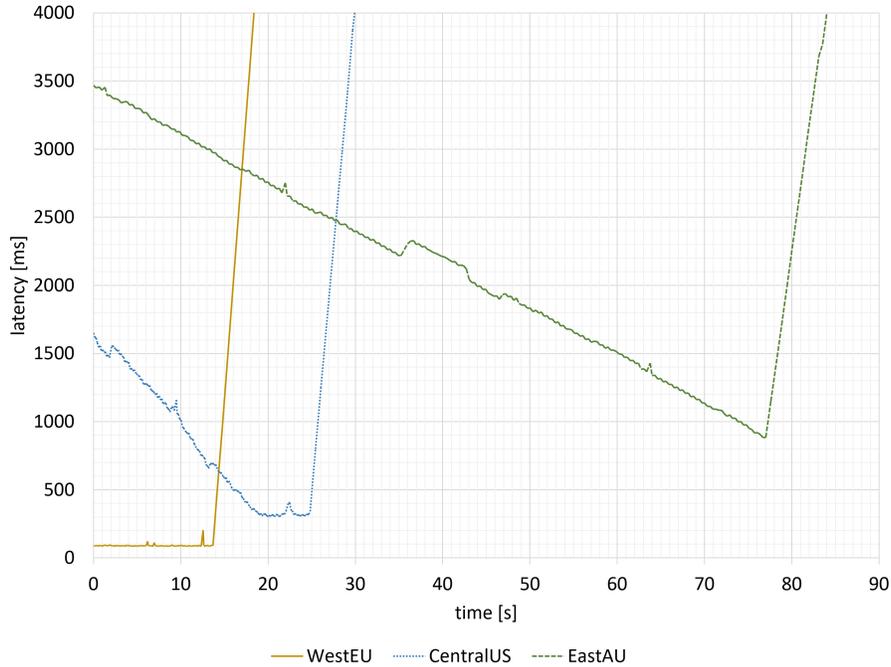


Figure 7: IoT Hub throttling.

one millisecond.

Based on all the aforementioned findings, we have decided to implement control algorithm for the laboratory model with all of the four communication protocols at WestEU location. These protocols could meet our requirement of 100ms latency. The success of the IoT Hub service depends on the duration of the regulation; while the other three protocols (WCF, HTTP and OPC UA) should be able to fulfill our regulation aims.

4. Networked Control System Evaluation

A laboratory model is developed to test the proposed CB-CPS architecture (Figure 8). The laboratory model works with the sampling time 100ms; therefore it does not require hard real-time control. This model was chosen because it can represent any industrial system with relatively slow dynamics

Table 3: Distribution RAMI 4.0 levels to the cloud

Level	Categ.	Cloud location	Protocol
Top-level	ERP	anywhere on Earth	WCF, HTTP, OPC, AMQP
	MES	anywhere on Earth	WCF, HTTP, OPC, AMQP
Station	>1s	anywhere on Earth	WCF, HTTP, OPC, AMQP
	>40ms	same continent	WCF, HTTP, OPC
Control	>1s	anywhere on Earth	WCF, HTTP, OPC, AMQP
	>40ms	same continent	WCF, HTTP, OPC
	<40ms	on LAN, or on device	real time protocols

(e.g. crane hook, path planning, etc.). The system is controlled by a PLC which is connected to the local computer in the laboratory through OPC DA connection. The model can be controlled both locally with PLC controller and remotely from the cloud with cloud services.

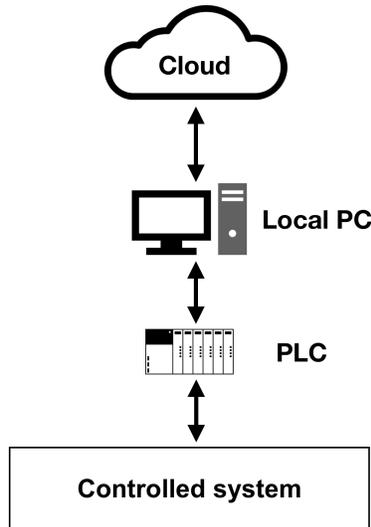


Figure 8: Proposed architecture for cloud control.

The laboratory model Traverse (Figure 9) is located in a laboratory at the Department of Cybernetics and Artificial Intelligence, Faculty of Electrical Engineering and Informatics at Technical University of Kosice.



Figure 9: Laboratory model Traverse.

325 The controlled agent offers a regulation of a ball on an inclined surface.
The inclined surface consists of two cylinders that are connected to the wooden
construction of the bridge (Figure 10). The length of the bridge is 67cm and
the diameter of the ball is 10cm. Thus, the total length of the path that the
ball can travel is 57cm from end to end. This bridge is suspended on two
330 steel cables connected to the axles of two asynchronous motors with an electro-
mechanic brake and incremental rotary encoders. Axle rotation of the left or
the right motor is transformed to the height change of the left or right end of
the bridge. The motors are controlled with two frequency converters. These
frequency converters are controlled by an analog signal from the PLC.



Figure 10: The bridge.

335 Position sensing of the ball is provided by the two cylinders that support ball.
One of the cylinders is made from brass, and the other is wrapped in copper
wire. These cylinders use the principles of rheostat to transform the physical
position of the ball to the voltage signal. This voltage signal is connected to the
analog voltage input of the PLC.

340 Despite its specific functions, this model can represent various kinds of agents
in an industrial system. One example is the industrial control systems. If there
is more than one agent in the system, it becomes a multi-agent system where
agents can collaborate or cooperate with each other.

This solution is an example of using cloud systems in the technological
345 level of control. Our solution tests the control algorithms implemented on a
cloud and proposes an architecture for the communication with the cloud.
This architecture can be used to migrate parts of the algorithms, that demand
high computing power, to the cloud. For example, processes of control that
use image recognition, neural networks and machine learning. To examine
350 control with the cloud technology, a PID algorithm was applied. This case
study compares local PID control and cloud-based PID control. In future
research and development, control algorithm with image recognition could also
be migrated to the cloud, based on proposed architecture.

Initially, the model Traverse has to be identified for the synthesis of the PID
355 controller. The equation (2) represents the kinematic model of the ball motion.

$$s = \frac{1}{2}gt^2I(\sin(\alpha) - f_d\cos(\alpha)) \quad (2)$$

Where s is the length of the path travelled by the ball in time t , g is gravity
acceleration, I represent torque of the ball, α is the inclination of the bridge
measured in degrees. Parameter f_d is the coefficient of rolling friction of the
ball that is quite high, due to the fact, that ball is tightly fitted between the
360 two cylinders. The coefficient of rolling friction was measured experimentally.
The transfer function of the system (3) in Laplace form ($F_S(s)$) is:

$$F_S(s) = \frac{1,422s^2 + 6,547s + 24,674}{s^3} \quad (3)$$

The PID controller was applied in classical closed-loop feedback control (Figure 11), where $w(t)$ is desired value, $e(t)$ is regulation error, $u(t)$ is system input, and $y(t)$ system output. PID control algorithm coefficients were then tested in the closed-loop system within software Matlab/Simulink with positive results for multiple desired output values.

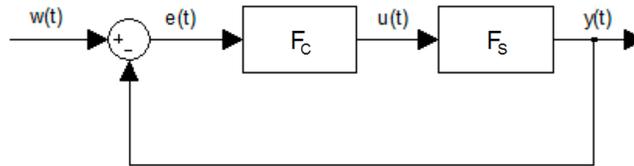


Figure 11: Feedback control scheme.

For the cloud-based control, a program with a graphical interface was created. The program was developed with the use of Microsoft Visual Studio 2017 development environment. The program works with 100ms sampling period. In every step, the actual position of the ball is downloaded from the PLC. This data is sent to the cloud, where the control algorithm is implemented. Then the computed control values are sent back from the cloud. After the program receives the control value from the cloud, the value is sent back to the PLC.

In this work, the response of the system for different desired values have been tested. These values represent the movement from the left side of the bridge to the desired value, represented by the percentage of the total length of the bridge. At the beginning of the measurement, the ball was always positioned at the left end of the bridge (refer to Figure 10). The left end of the bridge represents the position of 0%. In each test, the desired position was set at the beginning of the measurement.

Figure 12 shows the comparison of local and cloud control from 0% (left side of the bridge) to the 20% position. Under the cloud control, the ball position

progresses are similar for all four communication protocols; and the regulations
385 were all finished between 5th and 6th second. Whereas under the local control
algorithm, the regulation was finished in less than 3 seconds.

Figure 13 shows the comparison of local and cloud control from 0% to the
60% position. It can be seen that the ball position progresses are even more
similar than in the previous regulation, but it took longer to get the ball to the
390 desired position. For all four communication protocols, it took between 7 and
9 seconds to finish regulation. Again, local control was slightly faster, with a
regulation time equal to 6 seconds.

These experimental results proved that the developed system can be
successfully controlled through cloud services in which the latency is under
395 100ms. Even IoT Hub got the ball to the desired position because the
regulation was short and throttling was not applied. Mean latency for all
tested communication protocols was under 100ms in EastEU location. The
99.9% of all measured latency values of HTTP, WCF, and OPC UA protocols
were also under 100ms. In the case of IoT Hub, this number was higher, only
400 90% probability that the latency is under 103ms, but it was still sufficient for
the regulation.

Driven by these positive results, the cloud control was further implemented
through the EastUS data center. Figure 14 shows the comparison of cloud
control protocols from position 0% to 20%. It can be concluded from the figure
405 that HTTP communication (mean latency: 139ms, 99% of latency values are
under 152ms) can successfully control the ball to the desired position, although
the progress has more oscillations. WCF protocol (mean latency: 144ms, 99%
of values are under 160ms) can not control the model, and the ball is oscillating
around the desired position. OPC UA protocol (mean latency: 158ms, 90% of
410 values are under 179ms) can not control the model; the ball oscillates with an
increasing amplitude. The results of AMQP testing through EastUS location
(mean latency: 370ms, 99% of values are under 533ms) were not included in the
figure, since after multiple tests it was found that the ball was just bouncing
from the one side of the bridge to the other at high speeds, so we decided to

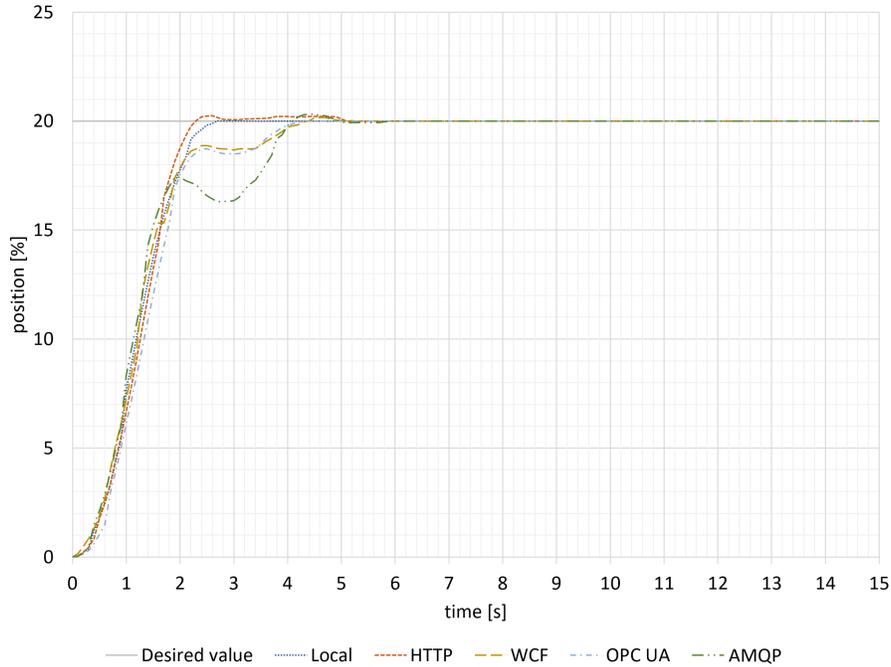


Figure 12: Comparison of local and cloud algorithms, $w=20\%$.

415 exclude AMQP protocol from this testing.

5. Conclusions and future work

In conclusion, the aim of this paper was to evaluate the network properties of the communication protocols eligible for the proposed CB-CPS. The main contribution is a thorough evaluation of different cloud providers, locations, and communication protocols to form recommendations sufficient for the cloud-based control in different levels of the RAMI 4.0 architecture. Relevant works conducted by other researchers have been reviewed. The RAMI 4.0 architecture has been analyzed with a focus on the control in each level. Various types of network measurements have been conducted based on our findings.

425 The network properties of three most commonly used cloud providers (Amazon Web Services, Google Cloud Platform, and Microsoft Azure) have

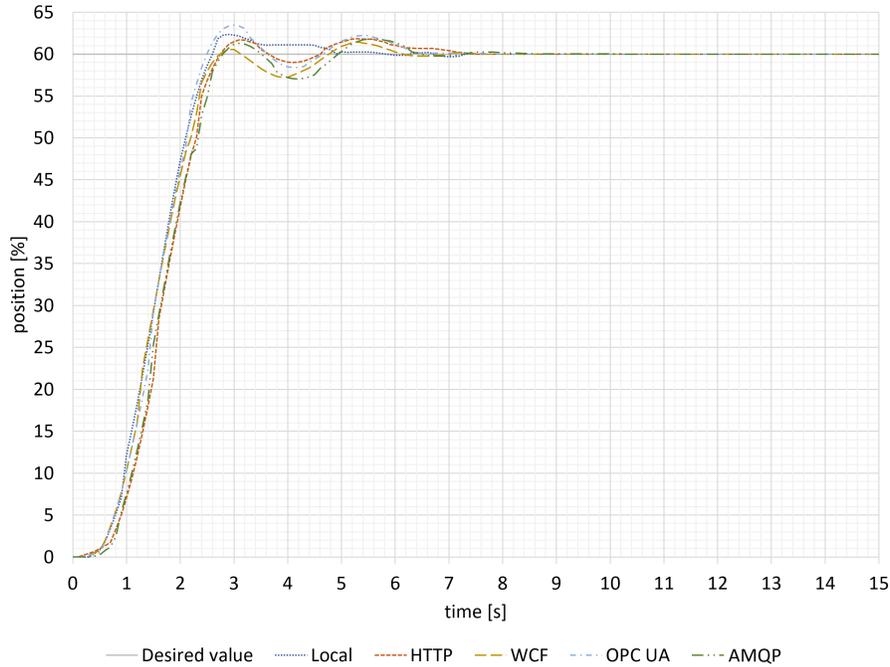


Figure 13: Comparison of local and cloud algorithms, $w=60\%$.

been evaluated. For all three providers, the latency to data centers in three different locations (west Europe, east United States, and eastern Australia) were tested. Based on the test results, Microsoft Azure cloud services was chosen for further study . Four different communication protocols (HTTP, WCF, OPC UA, and AMQP) were implemented and the latency of all protocols were analyzed and compared. All the measurements were made throughout the whole week at different times of the day.

All the experimental results have been recorded and analyzed in tables and figures. It was found that the time of the day and also the day of the week have a negligible impact on latency. HTTP was the fastest communication protocol among the four protocols, at all data centers locations. The overall order of the communication protocols, based on the latency, grouped by the location is the same for all locations. That means, data center utilization has minimal effect on the latency; the most significant impact is on the distance to the data

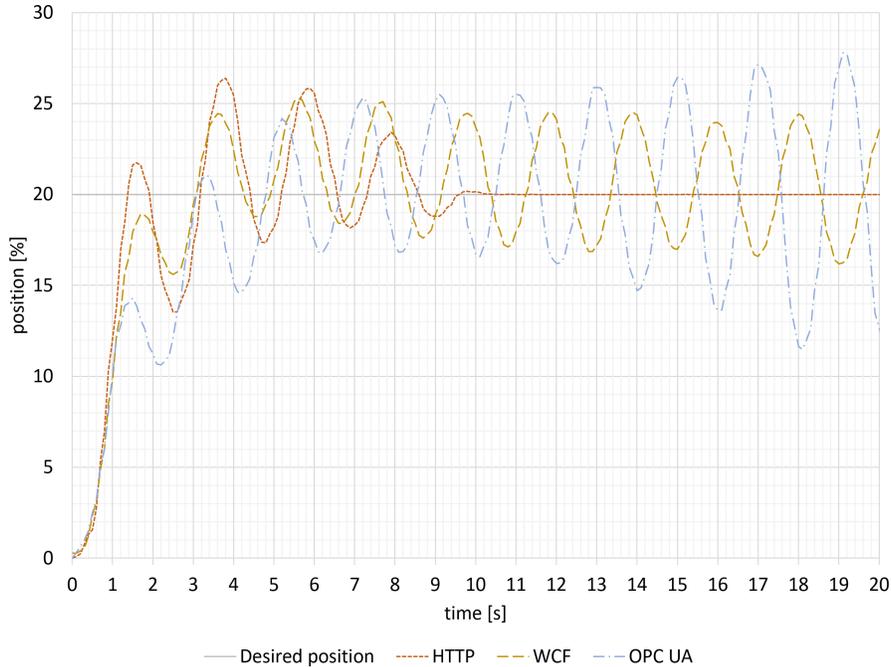


Figure 14: Comparison of cloud algorithms, $w=20\%$.

center and the speed of the communication channel. Results of HTTP and WCF were very similar in all locations; OPC UA is just slightly slower than the two mentioned. On the contrary, AMQP communication is a lot slower compared to the remaining three; also the dispersion of the values is a lot wider.

445 To prove that control can be done from the cloud services we have implemented a control algorithm through different communication protocols and data centers locations. It was found that communication protocols latency implemented in west Europe data centers are sufficient to control our laboratory model. At the east United States, the situation was different; only
 450 the fastest protocol (HTTP) was able to control the model successfully. Therefore, the latency limit for successful control is concluded to be around 139ms (also, at least 99% of values should be under 152ms).

Cloud requirements of the Station level of the RAMI 4.0 architecture and latency and data amount requirements of the other RAMI 4.0 hierarchy levels

455 have been analyzed. The feasibility of controlling each level of RAMI 4.0 through
cloud services were investigated. Experimental results showed that control is
possible in many solutions, but these solutions will not be depending just on
the cloud services. The intelligence on the edge of the network will play a
significant role [26]. The computing capacities of end devices are increasing;
460 fog/edge computing will shift intelligence closer to systems which will reduce
the amount of data that need to be transferred as well as shorten the latency.

It is worth mentioning that all these changes should be made with the needs
of the human in mind. In the time of automation and significant technological
innovations, there is a growing uncertainty about the role of humans in the
465 industry. Operators in the future will need to have a broader set of skills because
they will be working with the high-end HMI devices [27]. Therefore, there is an
urgent need to assess human factor in the frame of cyber-physical systems via
human-in-the-loop cyber-physical systems [28].

Moreover, cloud-based SCADA systems [29] as described in [30] is another
470 future research direction. In the future, a combination of these architectures
into one functional system will be developed. Our future work will focus on the
development and implementation of more distributed computational power, not
just towards the cloud, but also to the edge of the network – edge computing.

Acknowledgements

475 This publication was supported by the grant VEGA - 1/0663/17
Intelligent Cyber-Physical Systems in Heterogeneous Environment Supported
by IoE and Cloud Services. This work was supported by the European
Regional Development Fund in the Research Centre of Advanced Mechatronic
Systems project, project number CZ.02.1.01/0.0/0.0/16_019/0000867 within
480 the Operational Programme Research, Development and Education.

Declarations of interest

none

References

- [1] P. Marcon, F. Zezulka, I. Vesely, Z. Szabo, Z. Roubal, . Sajdl,
485 E. Gescheidtova, P. Dohnal, Communication technology for industry 4.0, in:
2017 Progress In Electromagnetics Research Symposium - Spring (PIERS),
2017, pp. 1694–1697. doi:10.1109/PIERS.2017.8262021.
- [2] M. Hermann, T. Pentek, B. Otto, Design principles for industrie 4.0
490 scenarios, in: 2016 49th Hawaii international conference on system sciences
(HICSS), IEEE, 2016, pp. 3928–3937. doi:10.1109/HICSS.2016.488.
- [3] Q. F. Hassan, Demystifying cloud computing, *CrossTalk: The Journal of
Defense Software Engineering* 24 (2011) 16–21.
- [4] R. Pethuru, R. Anupama, *The Internet of Things: Enabling Technologies,
Platforms, and Use Cases*, CRC Press, 2017.
- 495 [5] K. Schweichhart, Reference architectural model industrie 4.0 (rami 4.0)
- an introduction, *Standardization & Reference Architecture - Plattform
Industrie 4.0*, 2015.
- [6] X. Xu, Machine tool 4.0 for the new era of manufacturing, *The International
Journal of Advanced Manufacturing Technology* 92 (5-8) (2017) 1893–1900.
500 doi:10.1007/s00170-017-0300-7.
- [7] C. Liu, H. Vengayil, R. Zhong, X. Xu, A systematic development method
for cyber-physical machine tools, *Journal of Manufacturing Systems* (2018)
1–12doi:10.1016/j.jmsy.2018.02.001.
- [8] C. Liu, H. Vengayil, Y. Lu, X. Xu, A cyber-physical machine tools platform
505 using opc ua and mtconnect, *Journal of Manufacturing Systems* 51 (2019)
61–74.
- [9] R. Zhong, C. Xu, C. Chen, G. Huang, Big data analytics for physical
internet-based intelligent manufacturing shop floors, *International Journal*

- of Production Research (2015) 2610–2621doi:10.1080/00207543.2015.
510 1086037.
- [10] C. Deng, R. Guo, C. Liu, R. Y. Zhong, X. Xu, Data cleansing for energy-saving: a case of cyber-physical machine tools health monitoring system, International Journal of Production Research 56 (1-2) (2018) 1000–1015.
- [11] R. A. Gupta, M. Chow, Networked control system: Overview and research
515 trends, IEEE Transactions on Industrial Electronics 57 (7) (2010) 2527–2535. doi:10.1109/TIE.2009.2035462.
- [12] O. Givehchi, J. Imtiaz, H. Trsek, J. Jasperneite, Control-as-a-service from the cloud: A case study for using virtualized plcs, IEEE International Workshop on Factory Communication Systems - Proceedings, WFCS
520 (2014) 1–4doi:10.1109/WFCS.2014.6837587.
- [13] J. Schlechtendahl, F. Kretschmer, Z. Sang, A. Lechler, X. Xu, Extended study of network capability for cloud based control systems, Robotics and Computer-Integrated Manufacturing 43 (2017) 89–95. doi:10.1016/j.rcim.2015.10.012.
- 525 [14] P. Masek, R. Fujdiak, K. Zeman, J. Hosek, A. Muthanna, Remote networking technology for iot: Cloud-based access for alljoyn-enabled devices, in: Proceedings of the 18th Conference of Open Innovations Association FRUCT, FRUCT Oy, 2016, pp. 200–205.
- [15] F. Zezulka, P. Marcon, Z. Bradac, J. Arm, T. Benesl, I. Vesely,
530 Communication systems for industry 4.0 and the iiot, IFAC-PapersOnLine 51 (6) (2018) 150–155.
- [16] K. Sladka, M. Babiuch, Application of control algorithms in. net micro framework technology, in: 2016 17th International Carpathian Control Conference (ICCC), IEEE, 2016, pp. 684–687.
- 535 [17] J. Schlechtendahl, F. Kretschmer, A. Lechler, V. A, Communication mechanisms for cloud based machine controls, in: Variety Management

- in Manufacturing. Proceedings of the 47th CIRP Conference on Manufacturing Systems, 2014, pp. 830–834. doi:10.1016/j.procir.2014.01.074.
- 540 [18] L. Hurbean, D. Fotache, Erp iii the promise of a new generation, in: The 13th International Conference on Informatics in Economy, Education, Research & Business Technologies, 2014, pp. 1–5. doi:10.13140/2.1.3906.1765.
- [19] J. Vasilev, The change from erp ii to erp iii systems, in: 3rd International Conferenece on Application of Information and Communication Technology and Statistics in Economy and Education (ICAICTSEE 2013), 2013, pp. 1–3. doi:10.13140/2.1.5109.7609.
- 550 [20] P. Helo, M. Suorsa, Y. Hao, P. Anussornnitisarn, Toward a cloud-based manufacturing execution system for distributed manufacturing, Computers in Industry 65 (4) (2014) 646 – 656. doi:10.1016/j.compind.2014.01.015.
- [21] K. Ji, W. J. Kim, Real-time control of networked control systems via ethernet, International Journal of Control, Automation and Systems 3 (4) (2005) 591–600.
- 555 [22] W3Schools, Hyper text transfer protocol, https://www.w3schools.com/whatis/whatis_http.asp.
- [23] Microsoft, Windows communication foundation, <https://docs.microsoft.com/en-us/dotnet/framework/wcf/whats-wcf>.
- [24] OPC Foundation, Windows communication foundation, <https://opcfoundation.org/about/opc-technologies/opc-ua/>.
- 560 [25] ISO/IEC 19464, Advanced message queuing protocol, <https://www.amqp.org/>.

- [26] P. Papcun, E. Kajati, D. Cupkova, J. Mocnej, M. Miskuf, I. Zolotova, Edge-enabled iot gateway criteria selection and evaluation, *Concurrency and Computation: Practice and Experience*:doi:10.1002/cpe.5219. 565
- [27] I. Zolotova, P. Papcun, E. Kajati, M. Miskuf, J. Mocnej, Smart and cognitive solutions for operator 4.0: Laboratory h-cpps case studies, *Computers & Industrial Engineering*:doi:10.1016/j.cie.2018.10.032.
- [28] M. Jirgl, Z. Bradac, P. Fiedler, Human-in-the-loop issue in context of the cyber-physical systems, *IFAC-PapersOnLine* 51 (6) (2018) 225–230. 570
- [29] T. Lojka, I. Zolotova, Improvement of human-plant interactivity via industrial cloud-based supervisory control and data acquisition system, in: *IFIP International Conference on Advances in Production Management Systems*, Vol. 440, 2014, pp. 83–90. doi:10.1007/978-3-662-44733-8_11. 575
- [30] A. Sajid, H. Abbas, K. Saleem, Cloud-assisted iot-based scada systems security: A review of the state of the art and future challenges, *IEEE Access* 4 (2016) 1375–1384. doi:10.1109/ACCESS.2016.2549047.